


NOTES:

1. STONE SIZE: 75-125 mm (3-5") OPEN GRADED ROCK.
2. THICKNESS: NOT LESS THAN 200 mm (8").
3. WIDTH: NOT LESS THAN FULL WIDTH OF ALL POINTS OF INGRESS/EGRESS.

CITY OF AUSTIN DEPARTMENT OF PUBLIC WORKS	POND MAINTENANCE ROAD CROSS SECTION	
_____ ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO. 662S-2

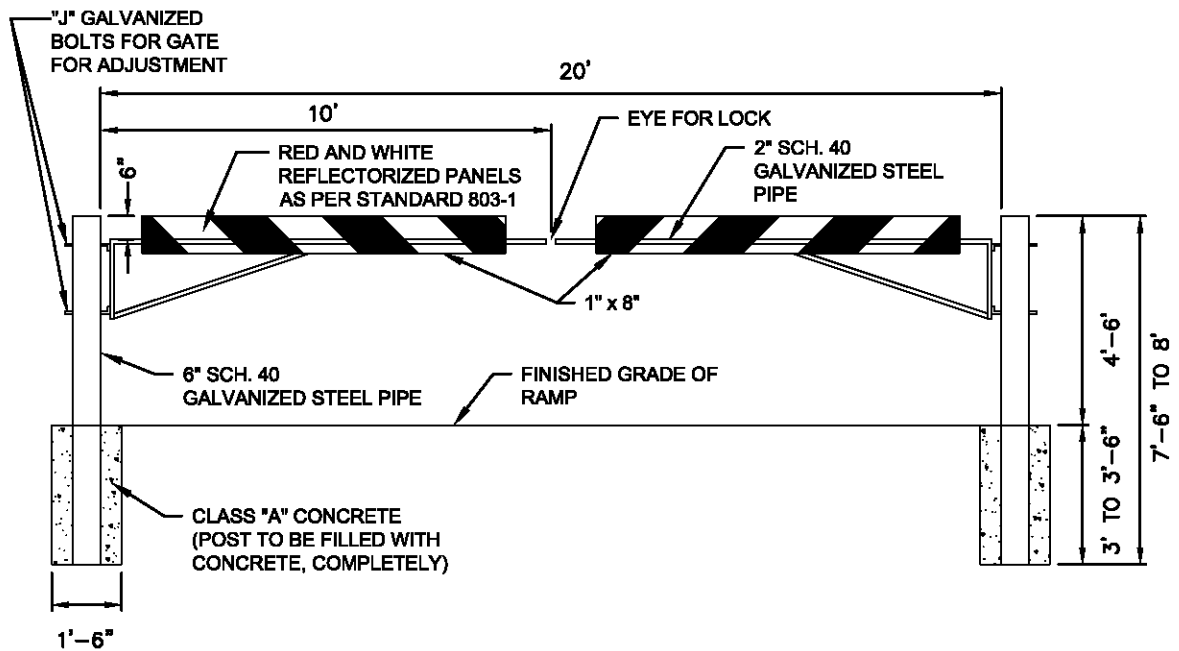

NOTE:
RAMP BARRICADE SUBSIDIARY
TO ITEM 403-G CONCRETE STRUCTURES


CITY OF AUSTIN
DEPARTMENT OF PUBLIC WORKS

POND PIPE GATE AT RAMP DETAIL

THE ARCHITECT/ENGINEER ASSUMES
RESPONSIBILITY FOR APPROPRIATE USE
OF THIS STANDARD.

STANDARD NO.
662S-1

ADOPTED

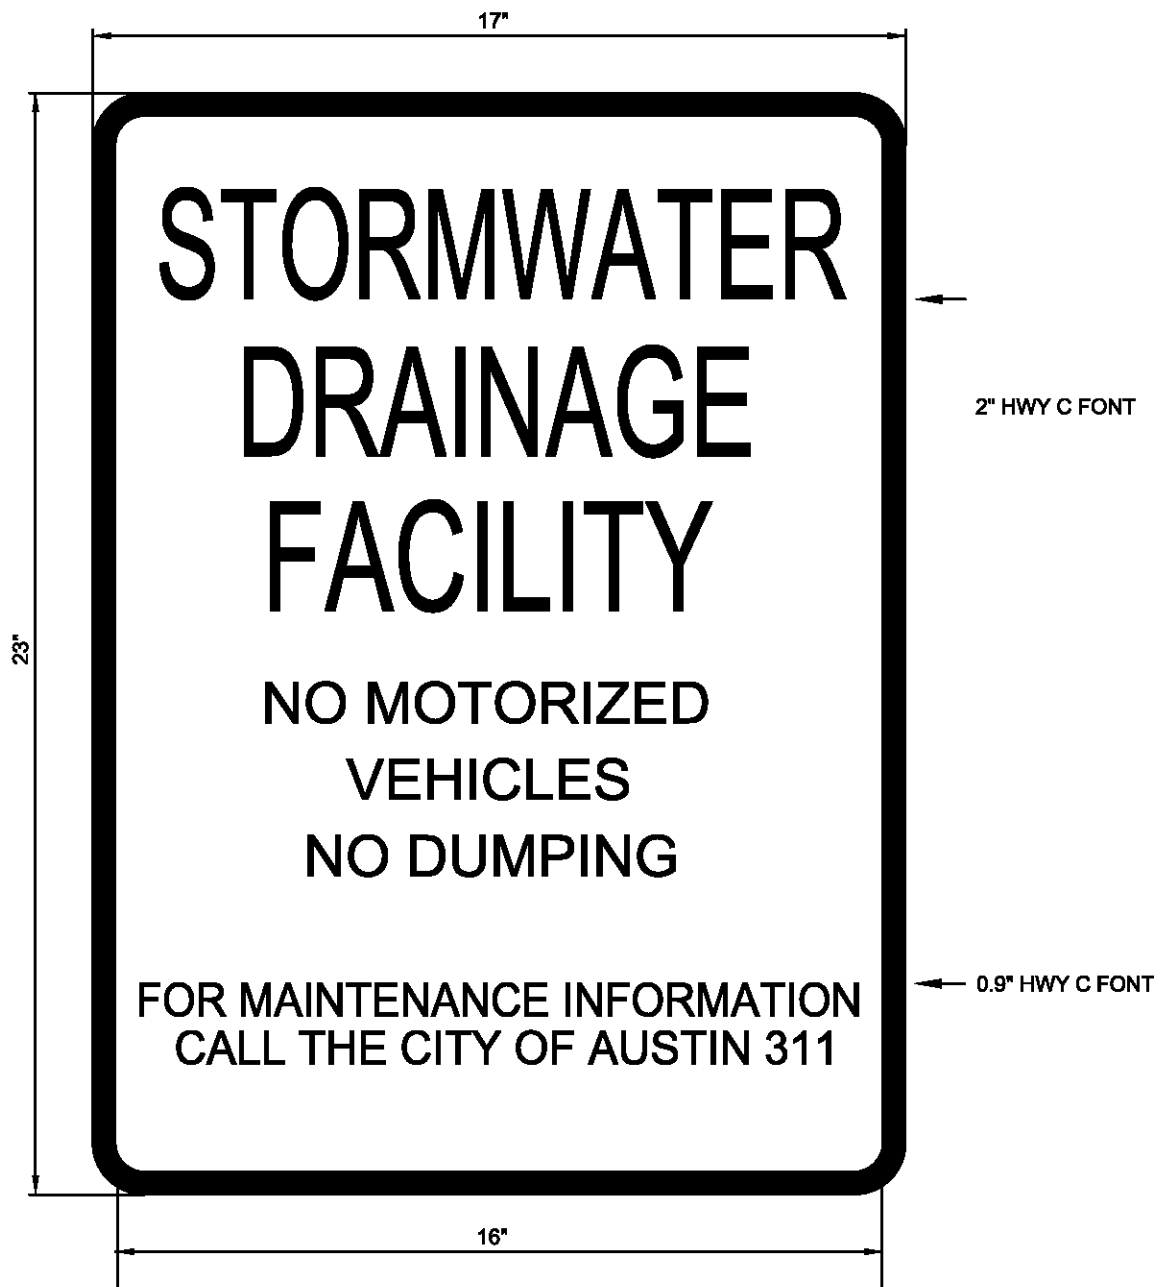

HEIGHT	24"
LENGTH	18"
THICKNESS	0.08"
SUBSTRATE	ALUMINUM ALLOY, 6061-T-6, OR TYPE IV 5052-H38 (ASTM B-209)
COLOR	LETTERING AND BORDER BLACK

CITY OF AUSTIN
DEPARTMENT OF PUBLIC WORKS

STORM WATER FACILITY SIGN

THE ARCHITECT/ENGINEER ASSUMES
RESPONSIBILITY FOR APPROPRIATE USE
OF THIS STANDARD.

STANDARD NO.

662S-3

ADOPTED